

National Fire Equipment Ltd.

Model 350 **Double Check Valve Assembly**

Application

Designed for installation on water lines to protect against both backsiphonage and backpressure of polluted water into the water supply. Assembly shall provide protection where a potential health hazard does not exists.

Standards Compliance (Horizontal & Vertical)

- ASSE® Listed 1015
- IAPMO® Listed
- CSA® Certified B64.5
- · AWWA Compliant C510
- · Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern Cali-
- UL® Classified (less shut-off valves only)
- · C-UL® Classified (less shut-off valves only

Materials

Cast Bronze, ASTM B 584 (3/4-1") Main valve body

Housing Reinforced Nylon

Stainless Steel, 300 Series **Fasteners** Silicone (FDA Approved) Elastomers Buna Nitrile (FDA Approved)

Internals Delrin, NSF Listed


Stainless Steel, 300 series Springs Cast Bronze, ASTM B 584 Ball Valves Struts Stainless Steel, 300 Series Handles Stainless Steel, 300 Series


Features

Sizes: 3/4", 1", 1-1/4", 1-1/2", 2"

Maximum working water pressure Maximum working water temperature

Hydrostatic test pressure End connections Threaded 175 PSI 180°F 350 PSI ANSI B1.20.1










Options

(Suffixes can be combined)

- with full port QT ball valves (standard)
- \Box L less ball valves, male pipe thread
- \sqcap S with Model SXL lead-free bronze "Y" type
- with integral male 45° flare SAE test fitting □ FT
- with blow out / flush fitting


Accessories

- ☐ Repair kit
- ☐ Thermal expansion tank (Model XT)
- □ QT-SET Quick Test Fitting Set
- ☐ Winterizing Blow out/Flush fitting (RK34-350BOF,
- ☐ RK1-350BOF or RK114-350-375BOF)

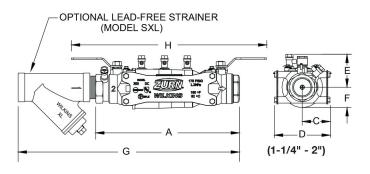

Dimensions & Weights (do not include pkg.)

MOE)FI	DIMENSIONS (approximate)													WEIGHT						
350 SIZE		А		B LESS BALL VALVES		С		D		E		F		G		н		LESS BALL VALVES		WITH BALL VALVES	
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg	lbs.	kg
3/4	20	11	279	6 5/8	168	1 7/8	48	3 3/4	95	3	76	1 1/4	32	15 1/8	384	11 7/16	291	2.3	1.0	4.3	2.0
1	25	12 1/4	311	7	178	2 1/16	52	4 1/8	105	3 1/4	83	1 3/4	45	17	431	12 5/16	313	3.0	1.4	6.0	2.7
1-1/4	32	14 7/8	378	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	20 1/2	521	18 1/2	470	17.2	7.8	19	8.6
1-1/2	40	15 1/4	387	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	22	559	20 1/4	514	17	7.7	20	9.1
2	50	16	406	14 3/8	367	3 3/8	86	6 3/4	171	3 3/4	95	2 1/4	57	24	609	20 3/4	527	18	8.2	22	10



TORONTO: (905) 761-6355 Toll Free: (800) 267-8508

VANCOUVER: (604) 420-1131 Toll Free: (800)-667-2138


www.nationalfire.com

BURNABY: (604)-299-4498 CALGARY: (403) 236-5661


EDMONTON: (780) 455-3870 Toll Free: (888)-891-1008

MONCTON: (506) 859-7277 Toll Free: (877) 816-3473 MISSISSAUGA: (905) 565-1385

MODEL 350 3/4" & 1" (STANDARD & METRIC)

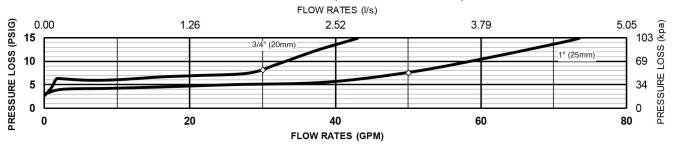


MODEL 350, 1-1/4", 1-1/2" & 2" (STANDARD & METRIC)

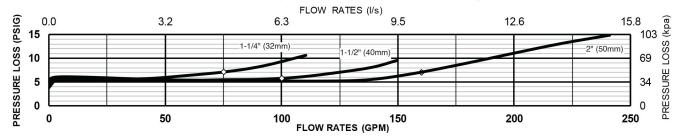


TYPICAL INSTALLATION

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. If installed below grade, be certain adequate drainage is provided to prevent the device from being submerged.

Capacity thru Schedule 40 Pipe										
Pipe size	5 ft/sec	7.5 ft/sec	10 ft/sec	15 ft/sec						
1/2"	5	7	9	14						
3/4"	8	12	17	25						
1"	13	20	27	40						
1 1/4"	23	35	47	70						
1 1/2"	32	48	63	95						
2"	52	78	105	167						



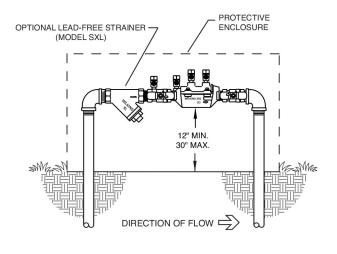

INDOOR INSTALLATION

OUTDOOR INSTALLATION

Specifications

The Double Check Valve Backflow Preventer shall be ASSE® Listed 1015, rated to 180°F and supplied with full port ball valves. The main body shall be Bronze for sizes 3/4" & 1", and Nylon for sizes 1-1/4" to 2". The housing shall be reinforced Nylon and the seat disc elastomers shall be silicone (FDA Approved). The first and second checks shall be accessible for maintenance without removing the device from the line. The Double Check Valve Backflow Preventer shall be a ZURN WILKINS Model 350.