



National Fire Equipment Ltd.

STRUCTURE ATTACHMENT FITTINGS



FUNCTION: Designed for bracing pipe against sway and seismic disturbances. Universal swivel design allows for attachment at any surface angle combined with concentric loading. Structure attachment fitting designed to use 1" thru 2" SCH 40 pipe, structural steel, and PHD 12 gauge strut channel (1001 & 1201) as sway bracing elements. No bracing member thicker than 3/8" can be used in conjunction with this product. Utilize the Fig. 030 with a PHD Manufacturing pipe attachment fitting and a bracing element to form a complete sway brace assembly. Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer's installation instructions.

SIZE: 1/2" mounting hole
Braces up to 8" Pipe MAX

FINISH: Electro-galvanized


MATERIAL: Ductile Iron and Low Carbon Steel

INSTALL: Mount device to structure then insert brace element into fitting against back of jaw. Tighten set screw finger tight, then tighten until hex head breaks off. Adjust attachment to proper brace angle.

APPROVALS: Underwriters Laboratories listed for US and Canada
Factory Mutual approved
Listed for use with NFPA fastener tables and PHD sway brace components only

ORDERING: Specify figure number

**Fig. 030
C-CLAMP
STRUCTURAL
ATTACHMENT**

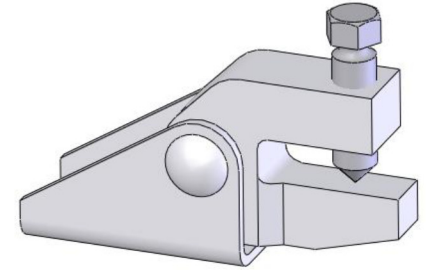

UL Maximum Design Loads (Up to 8" Pipe) Lateral & Longitudinal Assemblies						
Brace Member	Member Thickness	Member Length	lbs.	kN	Weight Ea.	
1" Thru 2" Pipe	SCH 40	Refer to NFPA13	2015	(8.96)	1.46	(0.66)
Structural Steel	3/8" thick MAX	Refer to NFPA13	2015	(8.96)		
1001 Series Strut	12 Ga.	See Chart Below	2015	(8.96)		
1201 Series Strut	12 Ga.	See Chart Below	2015	(8.96)		

FM Maximum Design Load For Bracing SCH 10, 40 & Flow Pipe				
Brace Member		Brace Angle From Vertical (Degrees)	lbs.	kN
1" Thru 2" SCH 40 Pipe	(GB/T3091, EN10255H, or JISG3454)	30°-44°	1270	(5.64)
		45°-59°	2040	(9.07)
		60°-74°	2450	(10.89)
		75°-90°	2740	(12.18)
1/4" Thru 3/8" Thick Structural Steel		30°-44°	900	(4.00)
		45°-59°	1280	(5.69)
		60°-74°	1570	(6.98)
		75°-90°	1750	(7.78)
PHD 12 Gauge Strut Channel 1001 & 1201		30°-44°	1070	(4.75)
		45°-59°	1440	(6.40)
		60°-74°	1740	(7.73)
		75°-90°	1940	(8.62)

Strut Fig. #	PHD Strut Channel Maximum Horizontal Load 90° From Vertical													
	r	l/r =	100			200			300					
			Max	lbs.	kN	Max	lbs.	kN	Max	lbs.	kN			
1001	0.580	(14.73)	58"	(1473.2)	4670	(20.77)	116"	(2946.4)	1165	(5.18)	174"	(4419.6)	518	(2.30)
1201	0.297	(7.54)	29"	(736.6)	3260	(14.50)	59"	(1498.6)	785	(3.49)	89"	(2260.6)	345	(1.53)

Unless otherwise specified, all dimensions on drawings and in charts are in inches and dimensions shown in parentheses are in millimeters.



National Fire Equipment Ltd.

TORONTO: (905) 761-6355
Toll Free: (800) 267-8508

OTTAWA: (613) 723-6071

VANCOUVER: (604) 420-1131
Toll Free: (800)-667-2138

BURNABY: (604)-299-4498

EDMONTON: (780) 455-3870
Toll Free: (888)-891-1008

CALGARY: (403) 236-5661

MONCTON: (506) 859-7277
Toll Free: (877) 816-3473

MISSISSAUGA: (905) 565-1385

www.nationalfire.com



PHD Manufacturing, Inc.
 44018 Columbiana-Waterford Road
 Columbiana, Ohio 44408-9481
 Phone: 800-321-2736 • 330-482-9256
 Fax: 330-482-2763
 Web: www.phd-mfg.com

FIG. 030 C-CLAMP STRUCTURAL ATTACHMENT

- Pipe Braced:** 8” Pipe MAX
Bracing: 1” thru 2” SCH 40 pipe, structural steel, and PHD 12 gauge strut channel (1001 & 1201)
Function: Designed for bracing pipe against sway and seismic disturbances. Universal swivel design allows for attachment at any surface angle combined with concentric loading. Structure attachment fitting designed to use 1” thru 2” SCH 40 pipe, structural steel, and PHD 12 gauge strut channel (1001 & 1201) as sway bracing elements. No bracing member thicker than 3/8” can be used in conjunction with this product. Utilize the Fig. 030 with a PHD Manufacturing pipe attachment fitting and a bracing element to form a complete sway brace assembly. Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer’s installation instructions.
- Approvals:** Underwriters Laboratories listed for US and Canada
 Factory Mutual approved
 Listed for use with NFPA13 fastener tables and PHD sway brace components only
- Material:** Ductile Iron and Low Carbon Steel
- Installation:** Mount device to structure then insert brace element into fitting against back of jaw. Tighten set screw finger tight, then tighten until hex head breaks off. Adjust attachment to proper brace angle.

UL Maximum Design Loads (Up to 8” Pipe)			
Brace Member	Member Thickness	Member Length	lbs.
1” Thru 2” Pipe	SCH 40	Refer to NFPA13	2015
NFPA13 Structural Steel	3/8” thick MAX	Refer to NFPA13	2015
1001 Series Strut	12 Ga.	See Chart Below	2015
1201 Series Strut	12 Ga.	See Chart Below	2015

FM Maximum Design Load			
For Bracing SCH 10, 40 & Flow Pipe			
Brace Member		Brace Angle From Vertical (Degrees)	lbs.
1” Thru 2” SCH 40 Pipe	(GB/T3091, EN10255H, or JISG3454)	30°-44°	1270
		45°-59°	2040
		60°-74°	2450
		75°-90°	2740
1/4” Thru 3/8” Thick Structural Steel		30°-44°	900
		45°-59°	1280
		60°-74°	1570
		75°-90°	1750
PHD 12 Gauge Strut Channel 1001 & 1201		30°-44°	1070
		45°-59°	1440
		60°-74°	1740
		75°-90°	1940

Strut Fig. #	Max. Horizontal Load (lbs.) 90° From Vertical							
	r	l/r =	100		200		300	
1001	0.580		58”	4670	116”	1165	174”	518
1201	0.297		29”	3260	59”	785	89”	345

NOTE: Use NFPA13 table “Allowable Horizontal Load on Brace Assemblies Based on the Weakest Component of the Brace Assembly” reduction factors for maximum loads at varying angles.

Refer to www.phd-mfg.com regarding further strut channel details
The Complete Line of Pipe Supports and Devices
 Pipe Hangers ▲ Strut & Accessories ▲ Pipe Clamps ▲ Beam Clamps ▲ Shields