



APPLICATION

The Pressure-Tru™ ZW4004SS Series Pressure Reducing Valve is listed as a floor control valve, an indicating valve, and a check valve in automatic sprinkler systems as well as a standpipe valve for CLASS I and CLASS III systems. Regulates pressure under both flow and no-flow conditions. The valve has a listed supervisory switch built in. Suitable for indoor / outdoor use. Tamper resistant housing can be rotated for easy wiring switch rated 3 amps @ 125 VAC. Normally open contacts are standard.



ZW4004GSS

STANDARDS COMPLIANCE

- UL® Listed
- C-UL® Listed
- NYC MEA 325-06-E

MATERIAL

Castings/internals Cast bronze ASTM B 584
Elastomers Buna Nitrile (FDA approved)
EPDM (FDA approved)


OPTIONS

(Suffixes can be combined)


- ☒ - angle type valve
- ☒ IL - in-line (globe type) valve
- ☒ G - with grooved inlet and outlet connections
- ☒ CH - with chrome finish
- ☒ SPECIFY - tapped & plugged inlet and outlet for pressure gauge (not available on angle grooved body)

FEATURES


Sizes: ☒ 2 1/2"
Maximum inlet pressure 400 psi
End connections (FNPT) ANSI B1.20.1
(Grooved) AWWA C606
Manufactured in the USA
Factory Set

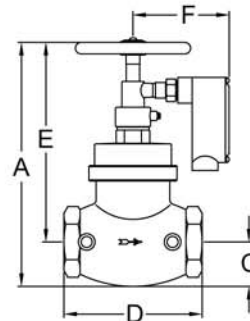


ZW4004ILSS

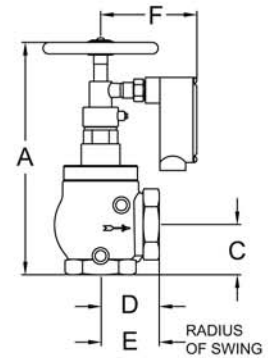

ZW4004SS

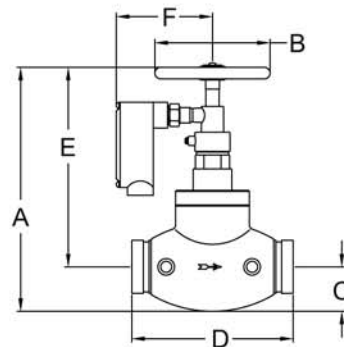

ZW4004ILGSS

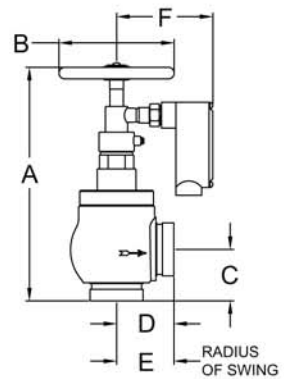





ZW4004GSS

DIMENSIONS & WEIGHTS (do not include pkg.)

MODEL	DIMENSIONS (approximate)													
	A OPEN		B		C		D		E Radius of Swing		F		WEIGHT	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs	kg
ZW4004SS	12 7/8	327	6 1/4	159	2 3/4	70	3 3/16	92	3 5/8	92	5 1/2	140	21	9.5
ZW4004ILSS	13 1/2	343	6 1/4	159	2 3/8	60	7 1/2	191	11	280	5 1/2	140	25	11.5
ZW4004GSS	12 7/8	327	6 1/4	159	2 3/4	70	3 3/16	81	n/a	n/a	5 1/2	140	20	9
ZW4004ILGSS	13 1/2	343	6 1/4	159	2 3/8	60	8 3/4	222	n/a	n/a	5 1/2	140	25	11.5

Residual Pressure Charts

For Pressure-Tru® 2 1/2" Models: ZW4000, ZW4000G, ZW4004 & ZW4004G

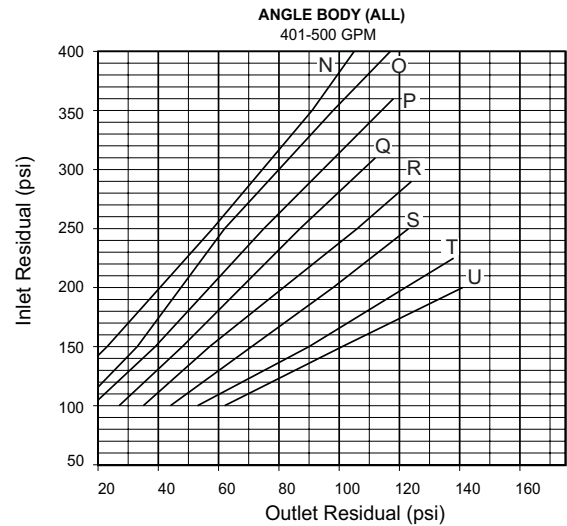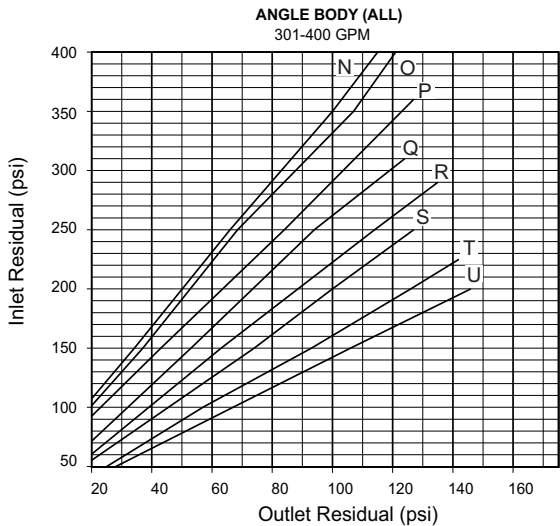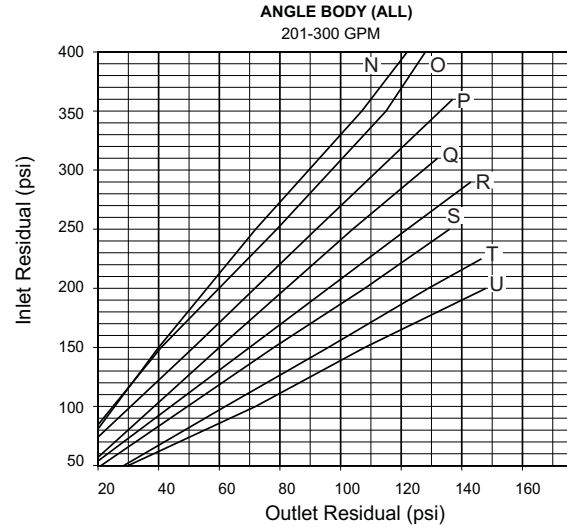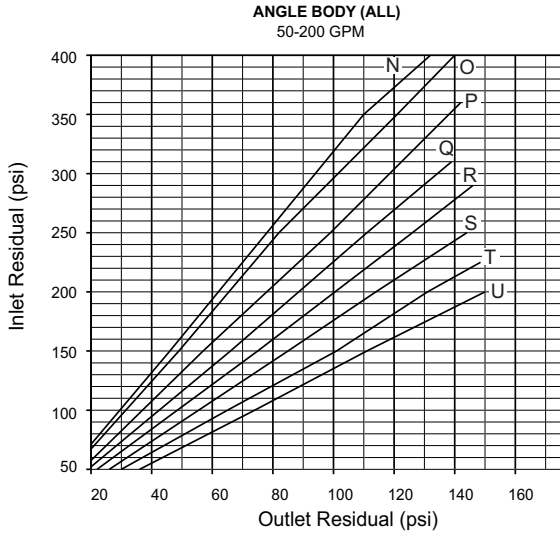

CHOOSING THE CORRECT SETTINGS

In designing a sprinkler system, a minimum of 20 psi pressure differential (the difference between the inlet static pressure and the valve outlet set static pressure) is recommended to assure a well regulated and efficient system. In choosing the correct setting for the Pressure-Tru® valve, refer to the Residual Pressure Charts, Static Pressure Chart and the following procedures:

1. Determine the demand in gallons per minute required downstream of the valve.
2. Determine the standpipe residual or "flow pressure" at the valve inlet.
3. Locate the appropriate flow chart based on GPM required and body style.
4. Locate the inlet residual pressure on the vertical axis of the chart and draw a horizontal line from this pressure across the chart.
5. Locate the desired valve outlet residual pressure on the horizontal axis of the chart and draw a vertical line from this pressure.
6. The curve nearest the intersection of the two lines drawn is the appropriate type for the valve.
7. To determine the static outlet pressure, locate the static chart. Determine the valve inlet static pressure shown on the vertical axis and draw a horizontal line from that pressure to the appropriate curve determined above, then draw a vertical line down to the horizontal axis and read the static outlet pressure.

MAXIMUM RATED INLET PRESSURE


Maximum inlet pressure, to assure a maximum outlet pressure of 175 psi. Inlet side of valves can be safely tested up to 400 PSI during system hydrostatic leak test.

Bonnet Type	Max Inlet Pressure psi (kpa)	
N	400	(2750)
O	400	(2750)
P	360	(2475)
Q	310	(2125)
R	290	(2000)
S	250	(1725)
T	225	(1550)
U	200	(1375)


Residual Pressure Charts

For Pressure-Tru® 2 1/2" Models: ZW4000IL & ZW4004IL


INLINE BODY (NPT)
50-100 GPM

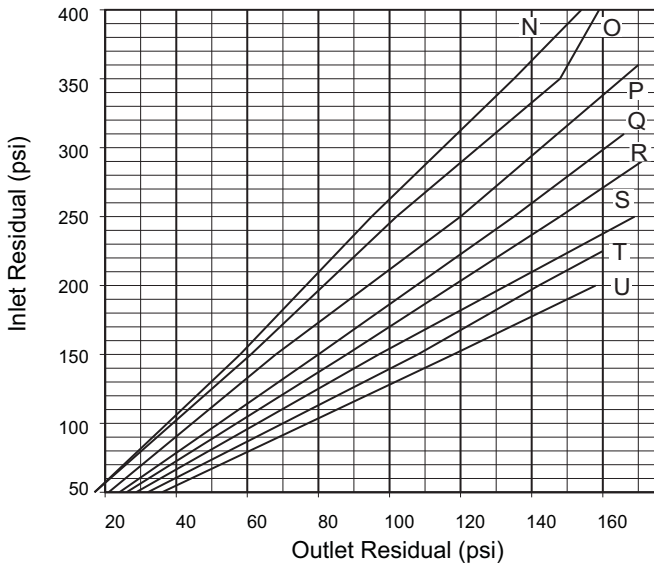


INLINE BODY (NPT)
301-400 GPM

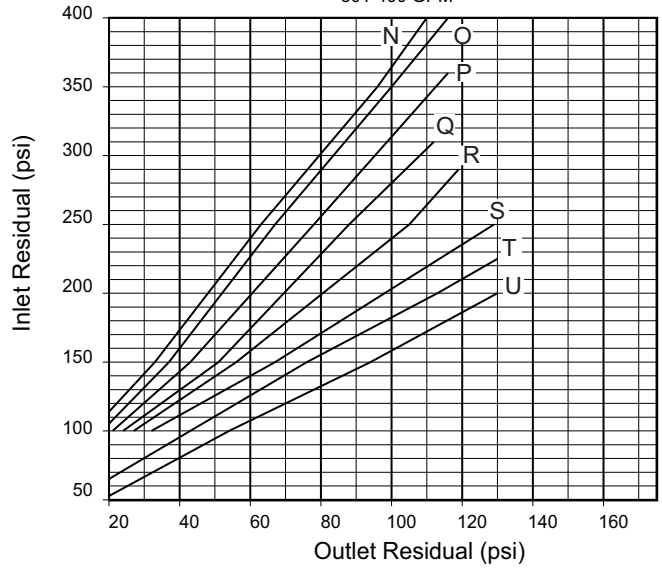


INLINE BODY (NPT)
101-200 GPM

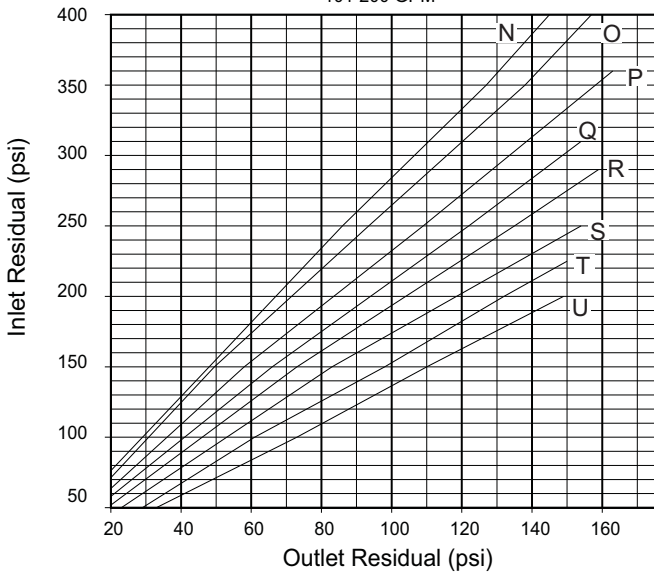


INLINE BODY (NPT)
401-500 GPM

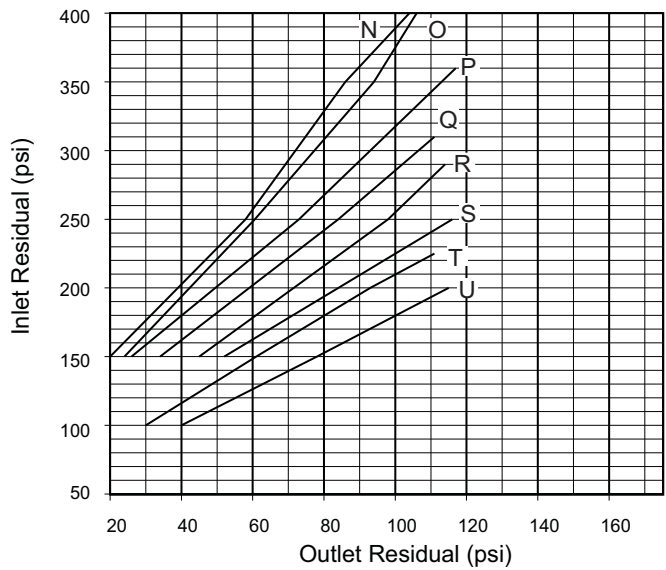

INLINE BODY (NPT)
201-300 GPM

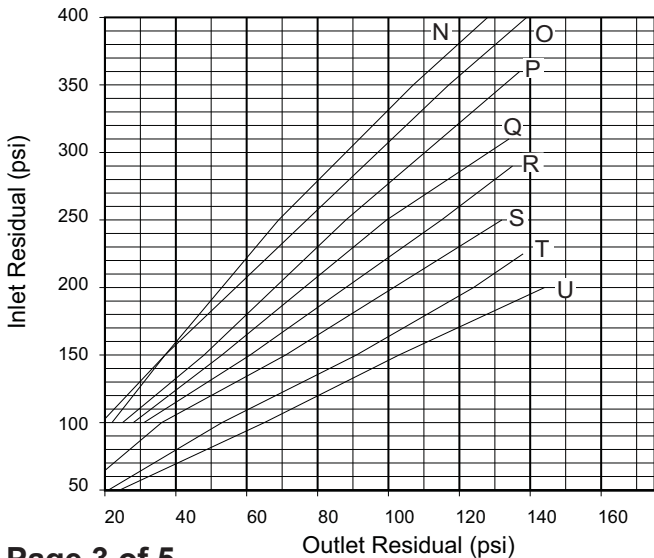


ANGLE & INLINE BODIES (ALL)
STATIC CHART

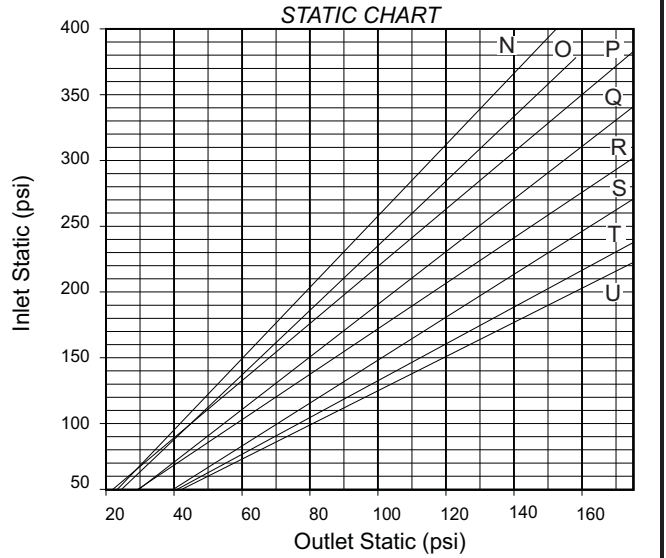


Residual Pressure Charts

For Pressure-Tru® 2 1/2" Models: ZW4000ILG & ZW4004ILG


INLINE BODY (GROOVED)
50-100 GPM

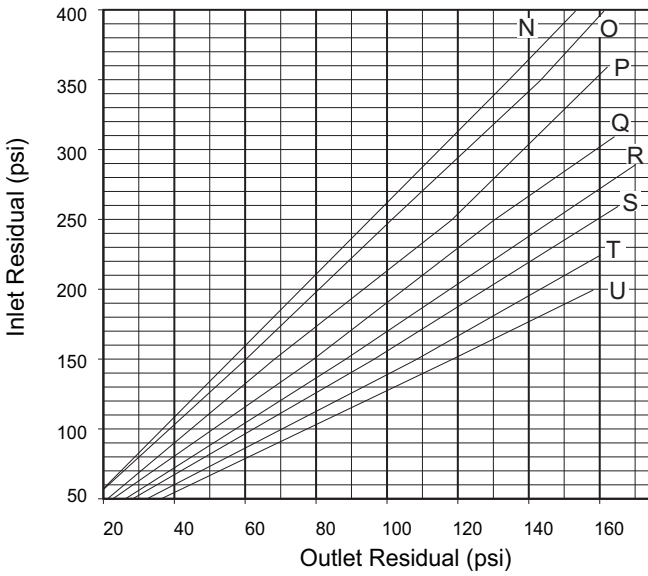


INLINE BODY (GROOVED)
301-400 GPM

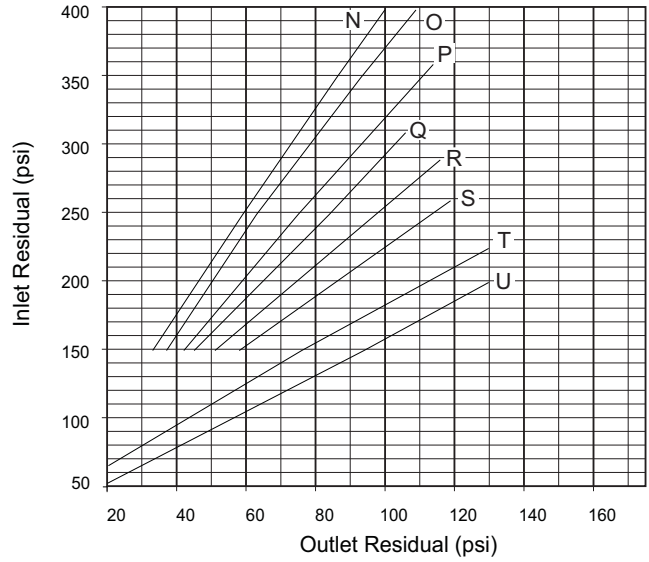


INLINE BODY (GROOVED)
101-200 GPM

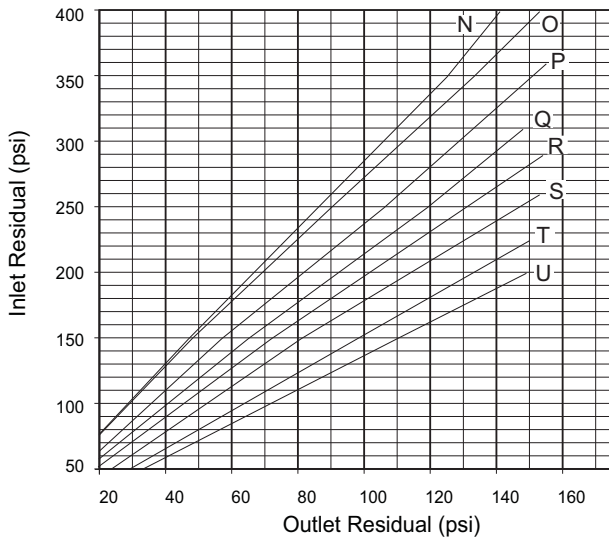

INLINE BODY (GROOVED)
401-500 GPM

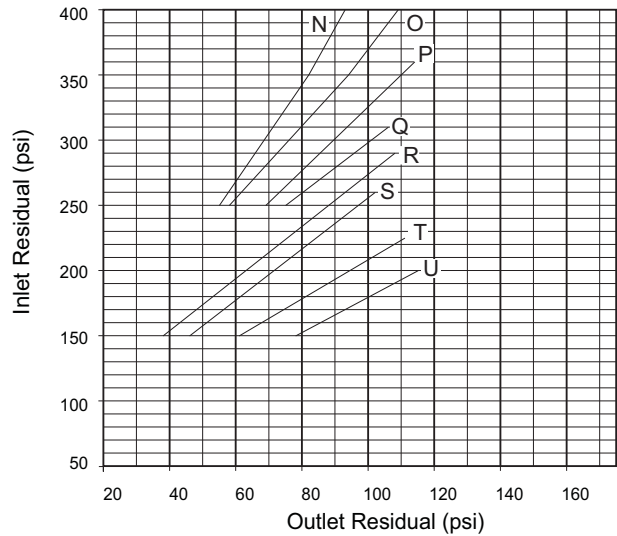

INLINE BODY (GROOVED)
201-300 GPM

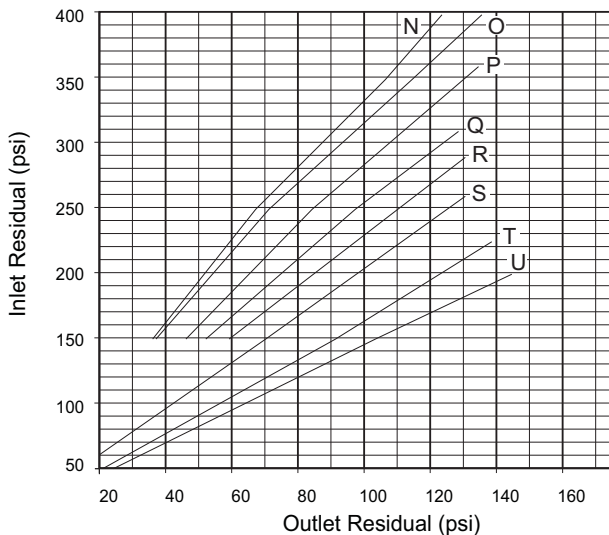

Proper performance is dependent upon licensed, qualified personnel performing regular, periodic testing according to WILKINS' specifications and prevailing governmental & industry standards and codes and upon following these installation instructions. Failure to do so releases WILKINS of any liability that it might otherwise have with respect to that device. Such failure could also result in an improperly functioning device.

WILKINS
a ZURN® company

ZW4000 Series Fire Valve

Part Number Assistant



Check off the boxes that match the choices you want. If the choice is blank, this is standard and you add nothing to the part number. If there are letters after the check box, then you add those letters to the part number in that order from left to right.

A bonnet setting has to be part of the part number since the ZW4000 series valves are factory set and not field adjustable. The flow curves **Must** be used by the system designer to select the correct bonnet setting.

Example
 2-1/2" ZW4004 Sprinkler Floor Control Valve (Factory Set)

<input type="checkbox"/> Angle Body <input checked="" type="checkbox"/> Globe Body <input checked="" type="checkbox"/> IL (choose one)	<input type="checkbox"/> Threaded Ends <input checked="" type="checkbox"/> Grooved Ends <input type="checkbox"/> G (choose one)	<input type="checkbox"/> SS Supervisory Switch <input type="checkbox"/> Monitor Switch <input checked="" type="checkbox"/> Adapter Bracket <input checked="" type="checkbox"/> MSA (choose one or none)	<input type="checkbox"/> No Handwheel <input type="checkbox"/> Capped Bonnet <input type="checkbox"/> CAP (choose one or none)	<input type="checkbox"/> Rough <input checked="" type="checkbox"/> Chrome Plated <input type="checkbox"/> CH (optional)	(choose one) Bonnet Setting Type <input type="checkbox"/> -N <input type="checkbox"/> -O <input type="checkbox"/> -P <input type="checkbox"/> -Q <input type="checkbox"/> -R <input type="checkbox"/> -S <input checked="" type="checkbox"/> -T <input type="checkbox"/> -U
--	---	---	--	---	---

In this example the part number would be ZW4004ILMSA-T

2-1/2" ZW4000 Standpipe Hose Valve (Factory Set)

<input type="checkbox"/> Angle Body <input checked="" type="checkbox"/> Globe Body <input type="checkbox"/> IL (choose one)	<input type="checkbox"/> Threaded Inlet <input type="checkbox"/> Grooved Inlet <input type="checkbox"/> G (choose one)	<input type="checkbox"/> 2-1/2" Hose thread <input type="checkbox"/> 3" Hose thread <input type="checkbox"/> SF Special Thread <input type="checkbox"/> ST _____ (choose one)	<input type="checkbox"/> w/ Cap & Chain <input type="checkbox"/> CC (optional)	<input type="checkbox"/> Rough <input type="checkbox"/> Chrome <input type="checkbox"/> Plated <input type="checkbox"/> CH (optional)	(choose one) Bonnet Setting Type <input type="checkbox"/> -N <input type="checkbox"/> -O <input type="checkbox"/> -P <input type="checkbox"/> -Q <input type="checkbox"/> -R <input type="checkbox"/> -S <input type="checkbox"/> -T <input type="checkbox"/> -U
---	--	--	---	--	--

Specify special thread

2-1/2" ZW4004 Sprinkler Floor Control Valve (Factory Set)

<input type="checkbox"/> Angle Body <input type="checkbox"/> Globe Body <input type="checkbox"/> IL (choose one)	<input type="checkbox"/> Threaded Ends <input type="checkbox"/> Grooved Ends <input type="checkbox"/> G (choose one)	<input type="checkbox"/> SS Supervisory Switch <input type="checkbox"/> Monitor Switch <input type="checkbox"/> Adapter Bracket <input type="checkbox"/> MSA (choose one or none)	<input type="checkbox"/> No Handwheel <input type="checkbox"/> Capped Bonnet <input type="checkbox"/> CAP (choose one or none)	<input type="checkbox"/> Rough <input type="checkbox"/> Chrome Plated <input type="checkbox"/> CH (optional)	(choose one) Bonnet Setting Type <input type="checkbox"/> -N <input type="checkbox"/> -O <input type="checkbox"/> -P <input type="checkbox"/> -Q <input type="checkbox"/> -R <input type="checkbox"/> -S <input type="checkbox"/> -T <input type="checkbox"/> -U
--	--	---	--	--	--

Specify if the body should be tapped and plugged for gauges.

Qty	Part number	Notes

40 Edilcan Drive, Concord, Ontario L4K 3S6 - Tel: (905) 761-6355 - Fax: (905) 761-6458 - 1-800-267-8508
 website: www.nationalfire.com

Document # Revision:
 OF-ZW4000SERIES 7/12